

# THE CONTROL SYSTEM DESIGN OF SCLF

Y.B. Yan†, J.G. Ding, G.Y. Jiang, J.F. Chen, Y.B. Leng,  
 H.F. Miao, Y.J. Liu, G.H.Chen, Q.R. Mi, H. Zhao, C.L. Yu, H.H. Lv, H.Y. Wang  
 Shanghai Institute of Applied Physics, Chinese Academy of Sciences,  
 201204 Shanghai, P.R. China

## Abstract

The high-gain free electron lasers have given scientists hopes for new scientific discoveries in many frontier research areas. The Shanghai Coherent Light Facility (SCLF) was proposed by the central government of China on April 2017, which is a quasi-continuous wave hard X-ray free electron laser facility. The control system is responsible for the facility-wide device control, data acquisition, machine protection, high level database or application, as well as network and computing platform. It will be mainly based on EPICS to reach the balance between the high performance and costs of maintenance. The latest technology will be adopted for the high repetition rate data acquisition and feedback system. The details of the control system design will be reported in this paper.

## OVERVIEW

The control system is responsible for the facility-wide device control, data acquisition, machine protection, high level database or application, as well as network and computing platform. It will provide operators, engineers and physicists with a comprehensive and easy-to-use tool to control the machine components to produce high quality electron beam and free electron laser.

According to the experience of SSRF and SXFEL, the control system of SCLF will be mainly based on EPICS (Experimental Physics and Industrial Control System) to reach the balance between the high performance and costs of maintenance. EPICS is a set of open source software tools, libraries and applications developed collaboratively and used worldwide to create distributed soft real-time control systems for scientific instruments such as particle accelerators, telescopes and other large scientific experiments [1].

## ARCHITECTURE

As shown in Figure 1, the control system can be divided into four layers to ensure the performance and scalability, which are operator interface layer, middle layer, device control layer and data acquisition layer.

The operator interface layer offers graphical user interface (GUI), command line interface (CLI) and high-level application programming interface (API) to operators, engineers and physicists. It allows them to interact with the machine components.

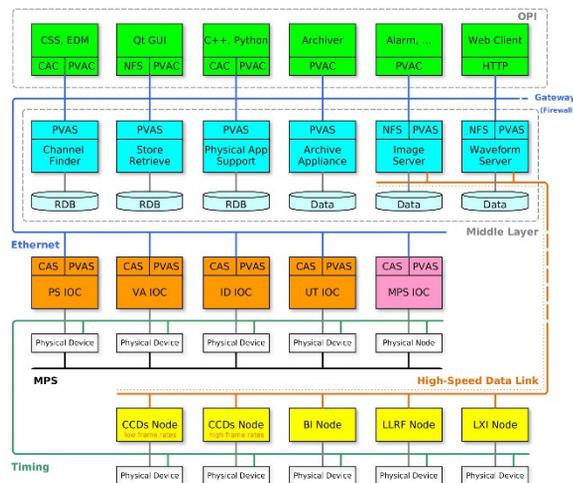


Figure 1: Architecture of the control system.

The middle layer consists of compute, storage and network devices. It provides the runtime environment for the whole control system. It also undertakes the centralized processing tasks for image and stream data acquisition system.

The device control layer is responsible for the facility-wide input and output device control, such as magnet power supply control, vacuum gauge control, stepper motor control and so on. The machine protection system will be also implemented in this layer. They are the basis components of the control system.

The data acquisition layer is designed for the high speed image and stream data acquisition, processing and storage. It involves the beam instrumentation, laser diagnostics and microwave related system. Some custom software will be used at this layer.

## SERVERS

The servers consist of several high performance computers, which provide the services as follows.

- EPICS Services: include the base, support modules, extensions, cross-compile support for different platforms. All console computers register on the server and use the shared resources, such as display manager.
- Network File Service: provide file sharing solution for the control system. The authorized clients can view and optionally store and update files on the server.

† yanyingbing@sinap.ac.cn

Content from this work may be used under the terms of the CC BY 3.0 licence (© 2018). Any distribution of this work must maintain attribution to the author(s), title of the work, publisher, and DOI.

- **Directory Services:** used for the authorization of accessing resources. The LDAP (Lightweight Directory Access Protocol) is adopted.
- **Archive Services:** store various runtime data for the parameters tracking and fault diagnosis. The scalar data will be achieved in channel archiver. The stream data will be achieved using dedicated system. The relational databases, non-relational databases or distributed file systems will be selected.
- **Time Synchronization Service:** use the NTP (Network Time Protocol) to synchronize the controllers, servers and console computers. It keep their internal clocks synchronized to a uniform reference time.

In addition to the above, other services are web service, backup service, software version control services, syslog service and so on.

The most services run on the virtual servers, which are highly scalable and available servers built on the cluster of physics servers. The architecture of the server cluster is fully transparent to the users. The virtual servers have been used for several years at SSRF, which improved the stability and reliability of the control system significantly.

## NETWORK

The network is the important infrastructure for modern distributed control system. The performance and reliability is critical. In this project, the Ethernet will be used as the backbone of control network. Most of hardware devices connect to 10 GbE access layer switches. The access layer switches have two connections to separate 40/100 GbE core switches, which is designed to ensure the reliability. The VLAN (Virtual Local Area Network) will be adopt, which divides the network into multiple subnets.

Several dedicated network will be built for the device control and data acquisition sub-system. For some high-speed cameras, point-to-point optical fiber connections will be used.

## DEVICE CONTROL

The device control is mainly responsible for the magnet power supply, vacuum gauge, ion pump, stepper motor and so on. The IOCs (Input / Output Controllers) are the key components of the control system. All the interfaces to hardware devices will be through the IOCs. The IOCs connect the local controllers via backplane bus, field buses or Ethernet. By using the protocol converters (including software and hardware), the devices with field buses such as RS-232/RS-485 can be reached via Ethernet.

The IOCs hardware must be COTS (Commercial Off-The-Shelf) products with the features of high performance and cost effective. The fanless industrial embedded controllers will be the best option, such as DA-68x series from MOXA or ARK-3000 series from AdvanTech.

## DATA ACQUISITION

The data acquisition is mainly responsible for the image acquisition for beam profile measurement and laser diagnostics system, stream data acquisition for beam

instrumentation system (position, charge, length and arrival-time measurement), microwave related system and general LXI devices (oscilloscope and spectrum analyzer). Due to high repetition rate, the large amount and high rate of data acquisition will be challenges.

The industrial cameras support multiple buses, such as FireWire, USB, GigE Vision, Camera Link, CoaXPress and so on. The GigE Vision is a globally accepted camera interface standard developed using the Gigabit Ethernet communication protocol. It offers the greatest technical flexibility in terms of bandwidth, cable length and multi-camera functionality. The Camera Link is a serial communication protocol standard designed for computer vision applications. It is used for the higher speed connectivity.

For the majority of low fps image acquisition, the GigE Vision cameras will be adopt. A dedicated network will be employed to transmit the images to the servers. The software will based on the areaDetector and aravisGigE modules. The image processing contains image rotations, flips, ROI (Region of Interest), profiles, etc.

For the minority of high fps image acquisition, the Camera Link cameras will be adopt. The Camera Link optical extender can be used to extend the data transmission distance over optical fiber links. The software mainly focus on the image acquisition and storage. The image processing and analysis will be completed offline.

For the LXI device, The LXI (LAN eXtensions for Instrumentation) consortium defines standard ways for Ethernet-based instruments to communicate, operate and function. The data is transmitted to the server through the dedicated network. The software will be developed via VISA (Virtual Instrument Software Architecture).

## SOFTWARE

The whole control system will be based on open-source software. The CentOS (Community enterprise Operating System) will be selected, which is a free operating system distribution based upon the Linux kernel. The major software will adopt the latest stable release series of EPICS Version 3. The components of Version 7 will be evaluated and used partially.

The most IOCs will be built with the existing records and device support modules. The StreamDevice will be used for the devices with serial communication interfaces, including RS-232, RS-485, GPIB, TCP/IP, etc. The netDev will be used for communicating with Omron and Yokogawa PLCs, s7nodave for Siemens S7 PLC. The custom IOCs will be based on asynDriver, which is a general purpose facility for interfacing device specific code to low level communication drivers.

The high level application plays an important role in the whole control system. It provides a platform to hold the information base, as well as a set of cooperating services for data access. It is composed of three layers: database, service and application, as shown in Figure 2.

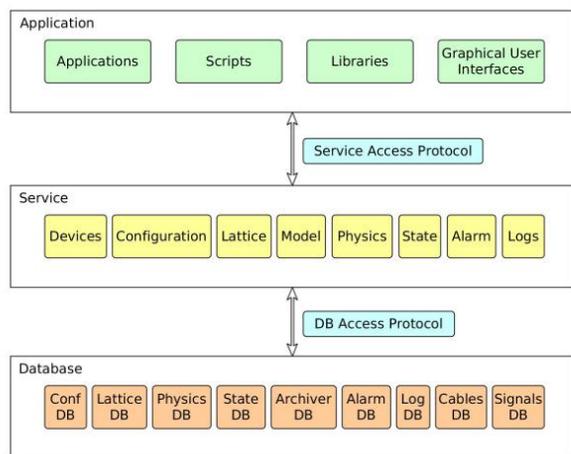


Figure 2: Architecture of the high level application.

The database is a general data storage container for the machine configuration, lattice, state, alarm and so on. The service implements a series of control and physical related logic operations, and provides standard interfaces for the application layer, including local interfaces and remote interfaces. The application layer consists of kinds of tools and components used to display the information to users. Both web-based and desktop-based interfaces will be implemented. The application layer accesses the database through the service layer.

The free electron laser facility is composed of many sub-systems. Combining data from multiple sources makes it possible to utilize data mining and analysis. The high level application provides operators, engineers and physicists easy-to-use programming interfaces to access the databases. It can simplify the application development, offload the heavy database query and shield from the database structure changes.

## TIMING

The timing system provides trigger and timestamps signals to the accelerator equipment, including injector, laser, modulators, beam and laser diagnostic system. The White Rabbit (WR) technology will be evaluated.

The White Rabbit is a collaborative project including CERN, GSI, and other partners from universities and industry. It can provide sub-nanosecond accuracy and picoseconds precision of synchronization for large distributed systems. It also allows for deterministic and reliable data delivery [2].

The timing system is composed of master, WR switch and node devices. The master receives reference signal from the synchronization system. The switches distribute the clock to all the nodes in the network using a hierarchical architecture. The node basic functionality comes in the form of an IP Core called WR PTP Core. They can be standalone trigger fanout modules or FMC boards, which can be embedded in the DBPM and MPS processor.

## MACHINE PROTECTION

The Machine Protection System (MPS) is designed to protect the important machine components from damage when serious abnormal situations occur. The system must be robust and reliable. It receives the interlock signals from the hardware devices and the timestamps signal from the timing system, performs the protection operations and reports the status to the operator interface layer. Take the vacuum system for example, the pressure in the vacuum chamber is continuously monitored via vacuum gauges and ion pump current. The vacuum valves are controlled by the machine protection system. An interlock action will close the proper isolation valves and stop the beam in case of anomalous pressure rises.

The system will be based on the FPGA (Field Programmable Gate Array) and adopts the hierarchical structure. It consist of two master nodes and several slave nodes. One master node receives and summarizes the signals from slave nodes of the injector and main accelerator. The other is employed for the undulators, beamlines and experimental stations. The slave nodes control the executive devices, such as the vacuum valve and so on. The nodes are connected via optical fiber instead of cables.

## CONCLUSION

The control system of SCLF will be a large scale real-time and interactive system with high reliability and stability. The latest protocols and standards will be adopted. There will be also many technical challenges due to the high repetition rate.

## REFERENCES

- [1] <http://www.aps.anl.gov/epics/index.php>
- [2] <http://www.ohwr.org/projects/white-rabbit>