

Improvement of Temperature and Humidity Measurement System for KEK Injector Linac

I. Satake[†], M. Satoh, T. Suwada, Y. Yano,
T. Kudou^{*}, S. Kusano^{*}, Y. Mizukawa^{*}

High Energy Accelerator Research Organization(KEK),

^{*}Mitsubishi Electric System & Service Co., Ltd

THMPA07

Temperature and Humidity Measurement System

- Consists of 26 data loggers connected to 720 sensors, one EPICS IOC, and CSS archiver.
- There are 17 types of objects to be measured.
- The temperature stability of the cooling water is very important for stable beam operation.
- The temperature change may cause the rf phase drift and eventually the beam energy change.

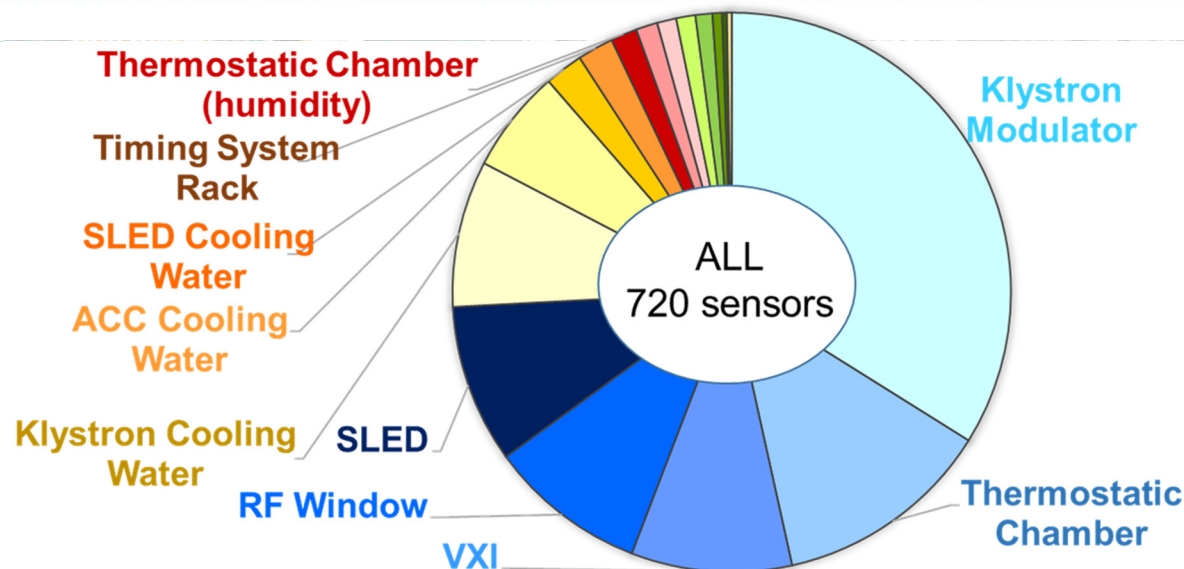


Fig.1: Measurement object.

Table 1: The stability goal of cooling water temperature

Type	Cooling water temperature
Accelerating structure and SLED	$30 \pm 0.3 \text{ }^{\circ}\text{C}$
Klystron	$30 \pm 0.5 \text{ }^{\circ}\text{C}$

Data logging system

- Measurement data obtained by each sensor is firstly sent to the data logger.
- EPICS IOC obtains the temperature data and stores them into EPICS PVs in 0.1 Hz.
- CSS archiver w/ PostgreSQL backend retrieves the data from EPICS PVs in 0.1 Hz.

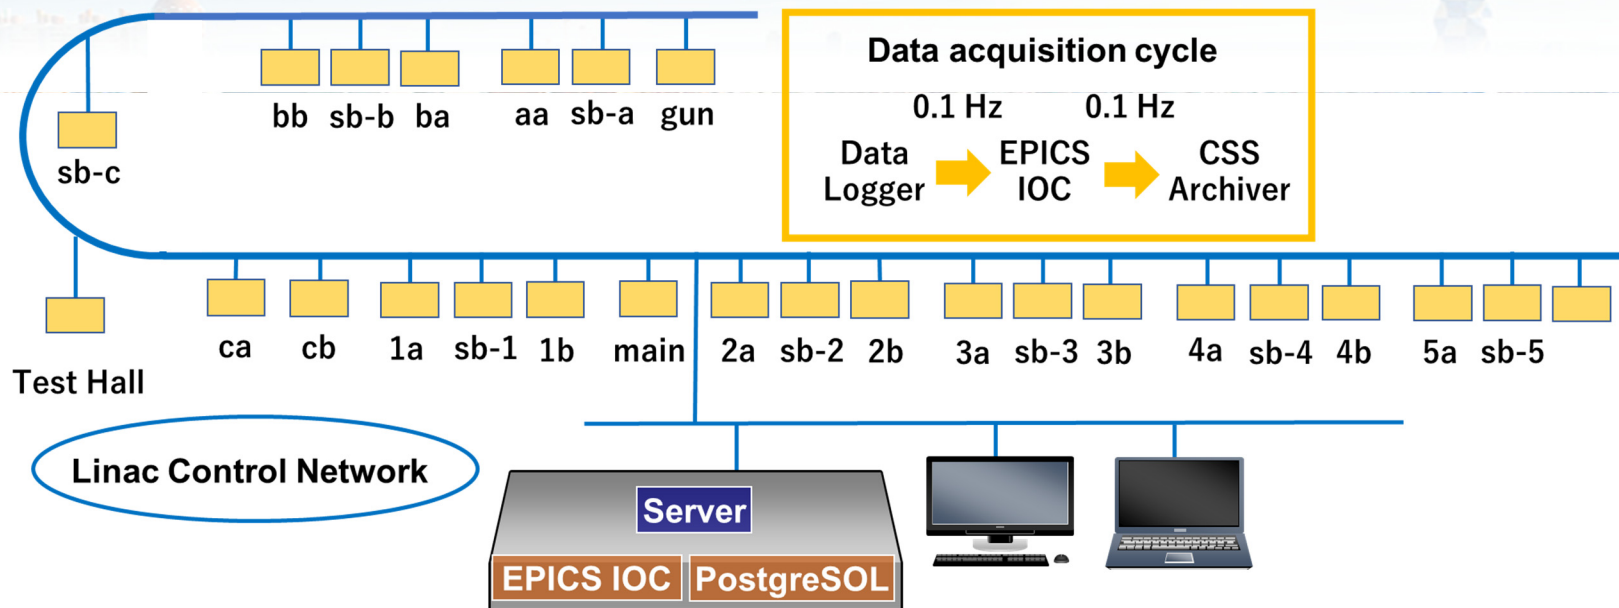


Fig. 2: Schematic layout of data acquisition software.

New Alarm System and Viewer

- Python scripting language, matplotlib, and Tkinter
- The new software for managing the temperature and humidity data.
- It can detect the anomalous temperature fluctuation with a good operable user interface.

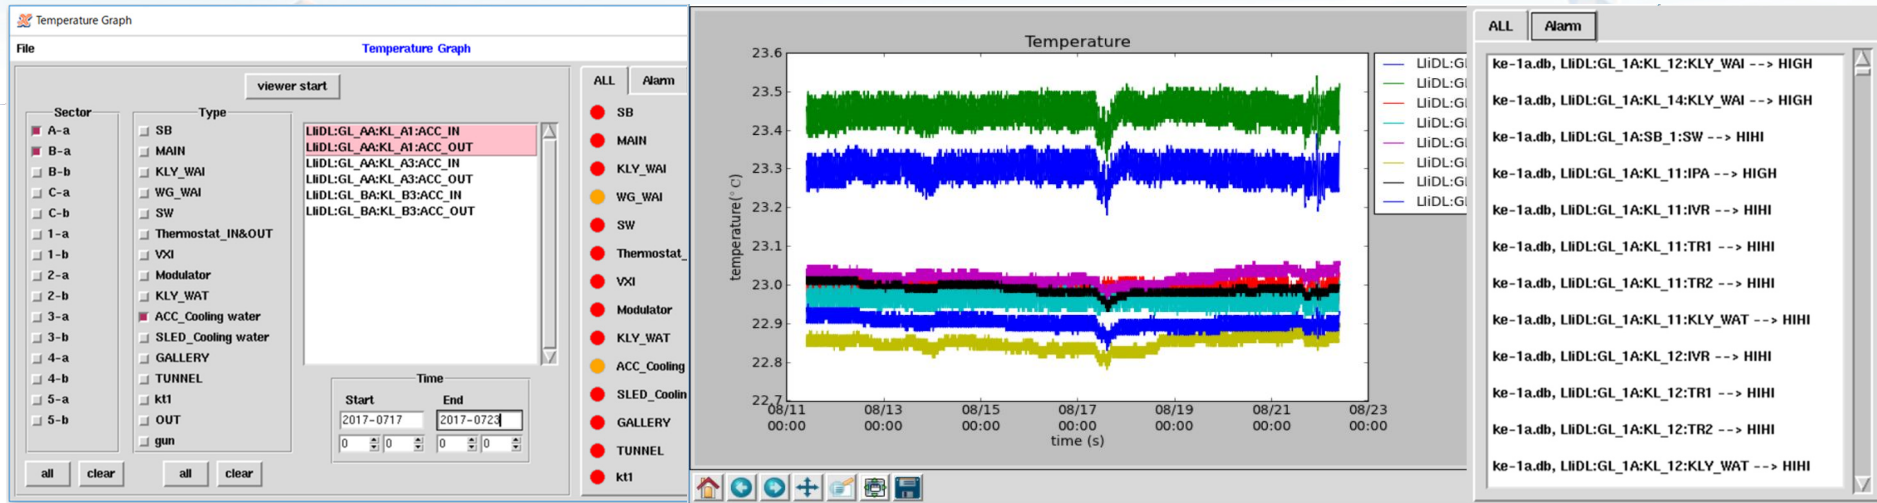


Fig. 3: Image example of the new archiver data viewer and alarm display panel.

- We have a plan to detect the defects of equipments by using this alarm system not only for the temperature but also for the status of other subsystems.